

IES INDOOR REPORT PHOTOMETRIC FILENAME : C6RX00-12-3712-UNVE10-S35S-NA.IES

DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002
[TEST] 11750395.15
[ECN] 3081
[TESTLAB] UL Verification Services Inc.
[ISSUEDATE] 5/4/2017
[MANUFAC] Tempo Industries Inc
[LUMCAT] C6RX00-12-3712-UNVE10-S35S-NA
[LUMINAIRE] Gray metal mounting bracket with brown housing and clear glass lens
[MORE] lens
[LAMP] 6 White LEDs with optic on each
[BALLAST] Magtech M18-U36-0500
[OTHER] 25.5 C, 120.048 V, 0.0836273 A, 9.98167 W, 0.994261 PF, 59.998
[MORE] 6 Hz
[OTHER] This test was performed using the calibrated photodetector method of absolute photometry.
[MORE] method of absolute photometry.

CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	849
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	85
Total Luminaire Watts	9.98167
Ballast Factor	1.00
CIE Type	Indirect
Spacing Criterion (0-180)	N.A.
Spacing Criterion (90-270)	N.A.
Spacing Criterion (Diagonal)	N.A.
Basic Luminous Shape	Rectangular
Luminous Length (0-180)	0.13 ft
Luminous Width (90-270)	0.96 ft
Luminous Height	0.00 ft



IES INDOOR REPORT
PHOTOMETRIC FILENAME : C6RX00-12-3712-UNVE10-S35S-NA.IES

LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	0	0	0
55	0	0	0
65	0	0	0
75	0	0	0
85	0	0	0

CANDELA TABULATION

	<u>0.0</u>	<u>22.5</u>	<u>45.0</u>	<u>67.5</u>	<u>90.0</u>
0.0	0.0	0.0	0.0	0.0	0.0
0.5	0.0	0.0	0.0	0.0	0.0
1.0	0.0	0.0	0.0	0.0	0.0
1.5	0.0	0.0	0.0	0.0	0.0
2.0	0.0	0.0	0.0	0.0	0.0
2.5	0.0	0.0	0.0	0.0	0.0
3.0	0.0	0.0	0.0	0.0	0.0
3.5	0.0	0.0	0.0	0.0	0.0
4.0	0.0	0.0	0.0	0.0	0.0
4.5	0.0	0.0	0.0	0.0	0.0
5.0	0.0	0.0	0.0	0.0	0.0
5.5	0.0	0.0	0.0	0.0	0.0
6.0	0.0	0.0	0.0	0.0	0.0
6.5	0.0	0.0	0.0	0.0	0.0
7.0	0.0	0.0	0.0	0.0	0.0
7.5	0.0	0.0	0.0	0.0	0.0
8.0	0.0	0.0	0.0	0.0	0.0
8.5	0.0	0.0	0.0	0.0	0.0
9.0	0.0	0.0	0.0	0.0	0.0
9.5	0.0	0.0	0.0	0.0	0.0
10.0	0.0	0.0	0.0	0.0	0.0
10.5	0.0	0.0	0.0	0.0	0.0
11.0	0.0	0.0	0.0	0.0	0.0
11.5	0.0	0.0	0.0	0.0	0.0
12.0	0.0	0.0	0.0	0.0	0.0
12.5	0.0	0.0	0.0	0.0	0.0
13.0	0.0	0.0	0.0	0.0	0.0
13.5	0.0	0.0	0.0	0.0	0.0
14.0	0.0	0.0	0.0	0.0	0.0
14.5	0.0	0.0	0.0	0.0	0.0
15.0	0.0	0.0	0.0	0.0	0.0
15.5	0.0	0.0	0.0	0.0	0.0
16.0	0.0	0.0	0.0	0.0	0.0
16.5	0.0	0.0	0.0	0.0	0.0
17.0	0.0	0.0	0.0	0.0	0.0
17.5	0.0	0.0	0.0	0.0	0.0
18.0	0.0	0.0	0.0	0.0	0.0
18.5	0.0	0.0	0.0	0.0	0.0
19.0	0.0	0.0	0.0	0.0	0.0
19.5	0.0	0.0	0.0	0.0	0.0
20.0	0.0	0.0	0.0	0.0	0.0
20.5	0.0	0.0	0.0	0.0	0.0
21.0	0.0	0.0	0.0	0.0	0.0
21.5	0.0	0.0	0.0	0.0	0.0
22.0	0.0	0.0	0.0	0.0	0.0
22.5	0.0	0.0	0.0	0.0	0.0
23.0	0.0	0.0	0.0	0.0	0.0
23.5	0.0	0.0	0.0	0.0	0.0
24.0	0.0	0.0	0.0	0.0	0.0
24.5	0.0	0.0	0.0	0.0	0.0
25.0	0.0	0.0	0.0	0.0	0.0
25.5	0.0	0.0	0.0	0.0	0.0
26.0	0.0	0.0	0.0	0.0	0.0
26.5	0.0	0.0	0.0	0.0	0.0

IES INDOOR REPORT
PHOTOMETRIC FILENAME : C6RX00-12-3712-UNVE10-S35S-NA.IES

CANDELA TABULATION - (Cont.)

27.0	0.0	0.0	0.0	0.0	0.0
27.5	0.0	0.0	0.0	0.0	0.0
28.0	0.0	0.0	0.0	0.0	0.0
28.5	0.0	0.0	0.0	0.0	0.0
29.0	0.0	0.0	0.0	0.0	0.0
29.5	0.0	0.0	0.0	0.0	0.0
30.0	0.0	0.0	0.0	0.0	0.0
30.5	0.0	0.0	0.0	0.0	0.0
31.0	0.0	0.0	0.0	0.0	0.0
31.5	0.0	0.0	0.0	0.0	0.0
32.0	0.0	0.0	0.0	0.0	0.0
32.5	0.0	0.0	0.0	0.0	0.0
33.0	0.0	0.0	0.0	0.0	0.0
33.5	0.0	0.0	0.0	0.0	0.0
34.0	0.0	0.0	0.0	0.0	0.0
34.5	0.0	0.0	0.0	0.0	0.0
35.0	0.0	0.0	0.0	0.0	0.0
35.5	0.0	0.0	0.0	0.0	0.0
36.0	0.0	0.0	0.0	0.0	0.0
36.5	0.0	0.0	0.0	0.0	0.0
37.0	0.0	0.0	0.0	0.0	0.0
37.5	0.0	0.0	0.0	0.0	0.0
38.0	0.0	0.0	0.0	0.0	0.0
38.5	0.0	0.0	0.0	0.0	0.0
39.0	0.0	0.0	0.0	0.0	0.0
39.5	0.0	0.0	0.0	0.0	0.0
40.0	0.0	0.0	0.0	0.0	0.0
40.5	0.0	0.0	0.0	0.0	0.0
41.0	0.0	0.0	0.0	0.0	0.0
41.5	0.0	0.0	0.0	0.0	0.0
42.0	0.0	0.0	0.0	0.0	0.0
42.5	0.0	0.0	0.0	0.0	0.0
43.0	0.0	0.0	0.0	0.0	0.0
43.5	0.0	0.0	0.0	0.0	0.0
44.0	0.0	0.0	0.0	0.0	0.0
44.5	0.0	0.0	0.0	0.0	0.0
45.0	0.0	0.0	0.0	0.0	0.0
45.5	0.0	0.0	0.0	0.0	0.0
46.0	0.0	0.0	0.0	0.0	0.0
46.5	0.0	0.0	0.0	0.0	0.0
47.0	0.0	0.0	0.0	0.0	0.0
47.5	0.0	0.0	0.0	0.0	0.0
48.0	0.0	0.0	0.0	0.0	0.0
48.5	0.0	0.0	0.0	0.0	0.0
49.0	0.0	0.0	0.0	0.0	0.0
49.5	0.0	0.0	0.0	0.0	0.0
50.0	0.0	0.0	0.0	0.0	0.0
50.5	0.0	0.0	0.0	0.0	0.0
51.0	0.0	0.0	0.0	0.0	0.0
51.5	0.0	0.0	0.0	0.0	0.0
52.0	0.0	0.0	0.0	0.0	0.0
52.5	0.0	0.0	0.0	0.0	0.0
53.0	0.0	0.0	0.0	0.0	0.0
53.5	0.0	0.0	0.0	0.0	0.0
54.0	0.0	0.0	0.0	0.0	0.0
54.5	0.0	0.0	0.0	0.0	0.0

IES INDOOR REPORT
PHOTOMETRIC FILENAME : C6RX00-12-3712-UNVE10-S35S-NA.IES

CANDELA TABULATION - (Cont.)

55.0	0.0	0.0	0.0	0.0	0.0
55.5	0.0	0.0	0.0	0.0	0.0
56.0	0.0	0.0	0.0	0.0	0.0
56.5	0.0	0.0	0.0	0.0	0.0
57.0	0.0	0.0	0.0	0.0	0.0
57.5	0.0	0.0	0.0	0.0	0.0
58.0	0.0	0.0	0.0	0.0	0.0
58.5	0.0	0.0	0.0	0.0	0.0
59.0	0.0	0.0	0.0	0.0	0.0
59.5	0.0	0.0	0.0	0.0	0.0
60.0	0.0	0.0	0.0	0.0	0.0
60.5	0.0	0.0	0.0	0.0	0.0
61.0	0.0	0.0	0.0	0.0	0.0
61.5	0.0	0.0	0.0	0.0	0.0
62.0	0.0	0.0	0.0	0.0	0.0
62.5	0.0	0.0	0.0	0.0	0.0
63.0	0.0	0.0	0.0	0.0	0.0
63.5	0.0	0.0	0.0	0.0	0.0
64.0	0.0	0.0	0.0	0.0	0.0
64.5	0.0	0.0	0.0	0.0	0.0
65.0	0.0	0.0	0.0	0.0	0.0
65.5	0.0	0.0	0.0	0.0	0.0
66.0	0.0	0.0	0.0	0.0	0.0
66.5	0.0	0.0	0.0	0.0	0.0
67.0	0.0	0.0	0.0	0.0	0.0
67.5	0.0	0.0	0.0	0.0	0.0
68.0	0.0	0.0	0.0	0.0	0.0
68.5	0.0	0.0	0.0	0.0	0.0
69.0	0.0	0.0	0.0	0.0	0.0
69.5	0.0	0.0	0.0	0.0	0.0
70.0	0.0	0.0	0.0	0.0	0.0
70.5	0.0	0.0	0.0	0.0	0.0
71.0	0.0	0.0	0.0	0.0	0.0
71.5	0.0	0.0	0.0	0.0	0.0
72.0	0.0	0.0	0.0	0.0	0.0
72.5	0.0	0.0	0.0	0.0	0.0
73.0	0.0	0.0	0.0	0.0	0.0
73.5	0.0	0.0	0.0	0.0	0.0
74.0	0.0	0.0	0.0	0.0	0.0
74.5	0.0	0.0	0.0	0.0	0.0
75.0	0.0	0.0	0.0	0.0	0.0
75.5	0.0	0.0	0.0	0.0	0.0
76.0	0.0	0.0	0.0	0.0	0.0
76.5	0.0	0.0	0.0	0.0	0.0
77.0	0.0	0.0	0.0	0.0	0.0
77.5	0.0	0.0	0.0	0.0	0.0
78.0	0.0	0.0	0.0	0.0	0.0
78.5	0.0	0.0	0.0	0.0	0.0
79.0	0.0	0.0	0.0	0.0	0.0
79.5	0.0	0.0	0.0	0.0	0.0
80.0	0.0	0.0	0.0	0.0	0.0
80.5	0.0	0.0	0.0	0.0	0.0
81.0	0.0	0.0	0.0	0.0	0.0
81.5	0.0	0.0	0.0	0.0	0.0
82.0	0.0	0.0	0.0	0.0	0.0
82.5	0.0	0.0	0.0	0.0	0.0

IES INDOOR REPORT
PHOTOMETRIC FILENAME : C6RX00-12-3712-UNVE10-S35S-NA.IES

CANDELA TABULATION - (Cont.)

83.0	0.0	0.0	0.0	0.0	0.0
83.5	0.0	0.0	0.0	0.0	0.0
84.0	0.0	0.0	0.0	0.0	0.0
84.5	0.0	0.0	0.0	0.0	0.0
85.0	0.0	0.0	0.0	0.0	0.0
85.5	0.0	0.0	0.0	0.0	0.0
86.0	0.0	0.0	0.0	0.0	0.0
86.5	0.0	0.0	0.0	0.0	0.0
87.0	0.0	0.0	0.0	0.0	0.0
87.5	0.0	0.0	0.0	0.0	0.0
88.0	0.0	0.0	0.0	0.0	0.0
88.5	0.0	0.0	0.0	0.0	0.0
89.0	0.0	0.0	0.0	0.0	0.0
89.5	0.0	0.0	0.0	0.0	0.0
90.0	0.0	0.0	0.0	0.0	0.0
90.5	0.1	0.0	0.0	0.0	0.0
91.0	0.1	0.0	0.0	0.0	0.1
91.5	0.0	0.0	0.0	0.0	0.1
92.0	0.0	0.0	0.0	0.0	0.2
92.5	0.0	0.1	0.0	0.1	0.2
93.0	0.0	0.0	0.1	0.1	0.3
93.5	0.0	0.0	0.1	0.1	0.3
94.0	0.1	0.0	0.0	0.2	0.4
94.5	0.0	0.0	0.0	0.3	0.5
95.0	0.0	0.0	0.1	0.3	0.5
95.5	0.1	0.0	0.1	0.4	0.7
96.0	0.1	0.1	0.1	0.4	0.7
96.5	0.1	0.1	0.1	0.6	0.9
97.0	0.1	0.1	0.2	0.7	1.0
97.5	0.1	0.1	0.3	0.8	1.2
98.0	0.1	0.2	0.4	0.9	1.3
98.5	0.1	0.2	0.4	1.0	1.5
99.0	0.2	0.3	0.5	1.2	1.6
99.5	0.3	0.4	0.7	1.3	1.8
100.0	0.3	0.4	0.8	1.4	2.0
100.5	0.4	0.5	0.9	1.6	2.2
101.0	0.5	0.6	1.1	1.7	2.4
101.5	0.6	0.7	1.2	1.9	2.6
102.0	0.6	0.8	1.5	2.1	2.8
102.5	0.8	1.0	1.7	2.3	3.0
103.0	0.9	1.1	1.9	2.4	3.3
103.5	1.0	1.3	2.2	2.6	3.6
104.0	1.1	1.5	2.4	2.8	3.9
104.5	1.3	1.7	2.7	3.1	4.1
105.0	1.5	1.9	2.9	3.2	4.4
105.5	1.7	2.2	3.2	3.5	4.7
106.0	2.0	2.4	3.4	3.8	5.0
106.5	2.4	2.6	3.7	4.0	5.3
107.0	2.7	2.9	4.0	4.2	5.6
107.5	3.0	3.2	4.3	4.5	5.9
108.0	3.3	3.5	4.6	4.8	6.3
108.5	3.6	3.8	4.8	5.0	6.6
109.0	3.9	4.1	5.1	5.4	7.0
109.5	4.3	4.6	5.4	5.7	7.3
110.0	4.6	5.1	5.7	6.0	7.7
110.5	5.0	5.6	6.0	6.3	8.0

IES INDOOR REPORT
PHOTOMETRIC FILENAME : C6RX00-12-3712-UNVE10-S35S-NA.IES

CANDELA TABULATION - (Cont.)

111.0	5.4	6.1	6.3	6.7	8.4
111.5	5.7	6.6	6.7	7.0	8.8
112.0	6.0	7.1	7.0	7.4	9.2
112.5	6.4	7.6	7.4	7.8	9.6
113.0	6.8	8.1	7.7	8.2	10.0
113.5	7.3	8.5	8.1	8.5	10.4
114.0	8.0	9.0	8.5	8.9	10.9
114.5	8.9	9.4	9.0	9.3	11.4
115.0	9.9	9.8	9.4	9.7	11.9
115.5	10.6	10.2	9.8	10.2	12.4
116.0	11.1	10.7	10.2	10.6	12.9
116.5	11.5	11.1	10.7	11.1	13.4
117.0	11.9	11.5	11.2	11.5	13.9
117.5	12.3	12.0	11.6	12.0	14.4
118.0	12.7	12.4	12.0	12.5	15.0
118.5	13.1	12.8	12.5	13.0	15.5
119.0	13.4	13.3	13.0	13.6	16.2
119.5	13.7	13.6	13.5	14.1	16.7
120.0	14.1	14.0	14.0	14.7	17.3
120.5	14.5	14.4	14.5	15.3	18.0
121.0	14.8	14.8	15.0	15.9	18.7
121.5	15.1	15.2	15.6	16.6	19.4
122.0	15.5	15.6	16.1	17.3	20.1
122.5	15.7	16.0	16.6	17.9	21.0
123.0	16.0	16.4	17.1	18.7	21.8
123.5	16.2	16.8	17.7	19.4	22.7
124.0	16.5	17.2	18.2	20.2	23.5
124.5	16.7	17.6	18.7	21.0	24.5
125.0	17.0	17.9	19.2	22.0	25.6
125.5	17.3	18.3	19.7	22.9	26.8
126.0	17.5	18.6	20.2	23.9	28.2
126.5	17.7	18.9	20.7	25.1	29.6
127.0	18.0	19.2	21.1	26.2	31.3
127.5	18.1	19.5	21.6	27.3	33.4
128.0	18.3	19.8	22.1	28.6	35.6
128.5	18.5	20.1	22.5	30.0	38.4
129.0	18.7	20.4	23.0	31.4	41.4
129.5	19.0	20.7	23.4	33.0	45.0
130.0	19.3	21.0	23.9	34.6	49.0
130.5	19.5	21.3	24.4	36.2	53.4
131.0	19.7	21.4	24.8	38.0	58.2
131.5	19.9	21.7	25.3	40.0	63.5
132.0	20.2	21.9	25.8	42.0	69.4
132.5	20.4	22.1	26.3	44.3	75.8
133.0	20.8	22.3	26.9	46.6	82.7
133.5	21.0	22.5	27.5	49.1	90.2
134.0	21.2	22.8	28.1	51.9	98.5
134.5	21.4	22.9	28.7	54.6	107.2
135.0	21.7	23.2	29.4	57.6	116.3
135.5	21.9	23.4	30.2	60.8	126.5
136.0	22.2	23.6	30.9	64.2	137.3
136.5	22.6	23.9	31.8	67.9	149.1
137.0	22.8	24.2	32.7	71.6	161.6
137.5	23.3	24.6	33.7	75.8	174.3
138.0	23.7	25.0	34.8	80.0	188.7
138.5	24.1	25.3	35.8	84.7	203.7

IES INDOOR REPORT
PHOTOMETRIC FILENAME : C6RX00-12-3712-UNVE10-S35S-NA.IES

CANDELA TABULATION - (Cont.)

139.0	24.4	25.6	37.0	89.7	219.8
139.5	24.7	26.1	38.4	94.8	237.0
140.0	25.3	26.6	39.9	100.3	255.1
140.5	25.8	27.1	41.5	106.3	275.4
141.0	26.3	27.7	43.2	112.7	296.4
141.5	26.9	28.3	45.0	119.7	318.8
142.0	27.4	29.0	46.9	127.3	342.6
142.5	28.0	29.8	49.3	135.3	368.7
143.0	28.5	30.6	51.5	143.5	395.1
143.5	29.2	31.5	54.1	152.8	423.7
144.0	29.8	32.4	56.9	162.4	454.2
144.5	30.5	33.4	59.9	172.9	486.4
145.0	31.3	34.6	63.2	184.3	519.2
145.5	32.1	35.9	67.0	196.6	556.4
146.0	33.0	37.3	70.9	209.4	595.3
146.5	34.1	38.9	75.2	223.6	634.2
147.0	35.2	40.7	79.8	238.6	677.4
147.5	36.4	42.6	84.7	254.4	720.8
148.0	37.8	44.8	90.0	271.7	767.9
148.5	39.4	47.3	95.6	290.5	815.7
149.0	41.2	50.1	101.8	309.7	866.2
149.5	43.1	53.2	108.2	330.9	919.9
150.0	45.3	56.4	115.1	353.3	971.7
150.5	47.7	60.1	122.2	376.7	1030.0
151.0	50.5	64.2	130.1	402.8	1087.0
151.5	53.6	68.6	138.3	430.1	1148.0
152.0	57.0	73.6	146.8	458.6	1210.0
152.5	61.0	78.8	156.2	489.6	1275.0
153.0	65.3	84.8	165.7	521.0	1341.0
153.5	70.1	91.2	176.2	555.6	1408.0
154.0	75.4	98.1	187.1	590.5	1475.0
154.5	81.3	105.8	198.6	628.2	1546.0
155.0	87.9	114.1	210.9	667.3	1610.0
155.5	95.0	122.9	223.8	709.5	1680.0
156.0	103.0	132.5	237.9	752.4	1753.0
156.5	112.1	143.0	252.7	795.9	1817.0
157.0	121.5	154.0	269.0	839.9	1885.0
157.5	131.9	165.7	286.1	885.1	1945.0
158.0	143.3	177.9	304.3	931.7	2005.0
158.5	155.0	191.2	323.5	979.9	2065.0
159.0	168.0	205.0	344.5	1027.0	2123.0
159.5	182.0	219.6	367.0	1075.0	2174.0
160.0	196.5	235.0	390.5	1124.0	2223.0
160.5	212.5	251.5	416.6	1173.0	2259.0
161.0	228.4	269.1	443.6	1222.0	2297.0
161.5	246.1	287.7	472.2	1271.0	2334.0
162.0	264.8	307.6	502.5	1321.0	2363.0
162.5	285.0	328.5	534.8	1369.0	2389.0
163.0	305.7	351.4	569.1	1417.0	2414.0
163.5	328.4	376.8	605.7	1465.0	2431.0
164.0	352.7	402.9	644.1	1512.0	2446.0
164.5	379.9	432.0	685.1	1560.0	2456.0
165.0	408.1	464.0	729.0	1606.0	2471.0
165.5	439.7	499.0	776.3	1650.0	2478.0
166.0	474.0	537.4	827.1	1694.0	2474.0
166.5	510.9	578.5	879.9	1738.0	2479.0

IES INDOOR REPORT
PHOTOMETRIC FILENAME : C6RX00-12-3712-UNVE10-S35S-NA.IES

CANDELA TABULATION - (Cont.)

167.0	551.2	622.3	937.0	1779.0	2478.0
167.5	595.1	670.0	996.7	1820.0	2479.0
168.0	640.4	722.6	1058.0	1859.0	2475.0
168.5	694.0	779.0	1122.0	1899.0	2469.0
169.0	752.4	842.0	1191.0	1937.0	2463.0
169.5	815.8	908.9	1264.0	1977.0	2453.0
170.0	881.1	982.4	1340.0	2014.0	2448.0
170.5	956.2	1060.0	1411.0	2052.0	2440.0
171.0	1041.0	1145.0	1488.0	2090.0	2438.0
171.5	1128.0	1234.0	1569.0	2126.0	2434.0
172.0	1222.0	1327.0	1647.0	2163.0	2437.0
172.5	1324.0	1421.0	1731.0	2199.0	2440.0
173.0	1426.0	1522.0	1811.0	2238.0	2448.0
173.5	1533.0	1622.0	1896.0	2276.0	2460.0
174.0	1640.0	1728.0	1978.0	2315.0	2468.0
174.5	1754.0	1831.0	2056.0	2353.0	2478.0
175.0	1866.0	1933.0	2136.0	2390.0	2491.0
175.5	1979.0	2034.0	2208.0	2423.0	2505.0
176.0	2088.0	2132.0	2275.0	2453.0	2512.0
176.5	2191.0	2223.0	2340.0	2482.0	2519.0
177.0	2287.0	2307.0	2394.0	2503.0	2532.0
177.5	2370.0	2378.0	2442.0	2524.0	2537.0
178.0	2442.0	2442.0	2478.0	2542.0	2541.0
178.5	2503.0	2491.0	2507.0	2553.0	2545.0
179.0	2544.0	2525.0	2530.0	2559.0	2546.0
179.5	2572.0	2551.0	2545.0	2565.0	2545.0
180.0	2559.0	2559.0	2559.0	2559.0	2559.0

IES INDOOR REPORT
PHOTOMETRIC FILENAME : C6RX00-12-3712-UNVE10-S35S-NA.IES

ZONAL LUMEN SUMMARY

Zone	Lumens	%Lamp	%Fixt
0-20	0.00	N.A.	0.00
0-30	0.00	N.A.	0.00
0-40	0.00	N.A.	0.00
0-60	0.00	N.A.	0.00
0-80	0.00	N.A.	0.00
0-90	0.00	N.A.	0.00
10-90	0.00	N.A.	0.00
20-40	0.00	N.A.	0.00
20-50	0.00	N.A.	0.00
40-70	0.00	N.A.	0.00
60-80	0.00	N.A.	0.00
70-80	0.00	N.A.	0.00
80-90	0.00	N.A.	0.00
90-110	3.41	N.A.	0.40
90-120	13.27	N.A.	1.60
90-130	31.56	N.A.	3.70
90-150	158.99	N.A.	18.70
90-180	849.41	N.A.	100.00
110-180	846.00	N.A.	99.60
0-180	849.41	N.A.	100.00

Total Luminaire Efficiency = N.A.%

ZONAL LUMEN SUMMARY

Zone	Lumens
0-10	0.00
10-20	0.00
20-30	0.00
30-40	0.00
40-50	0.00
50-60	0.00
60-70	0.00
70-80	0.00
80-90	0.00
90-100	0.30
100-110	3.10
110-120	9.86
120-130	18.30
130-140	36.17
140-150	91.26
150-160	212.40
160-170	294.50
170-180	183.52


IES INDOOR REPORT
PHOTOMETRIC FILENAME : C6RX00-12-3712-UNVE10-S35S-NA.IES

COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
	RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	
0	95	95	95	95	81	81	81	81	56	56	56	32	32	32	10	10	10	0
1	87	83	79	76	74	71	68	65	48	47	45	28	27	26	9	9	8	0
2	79	72	66	62	67	62	57	53	42	40	37	24	23	22	8	7	7	0
3	72	63	57	51	61	54	49	44	37	34	31	21	20	18	7	6	6	0
4	65	56	48	43	56	48	42	37	33	29	26	19	17	16	6	6	5	0
5	60	49	42	36	51	42	36	32	29	25	22	17	15	13	5	5	4	0
6	55	44	36	31	47	38	32	27	26	22	19	15	13	11	5	4	4	0
7	50	39	32	27	43	34	28	23	23	19	17	14	11	10	4	4	3	0
8	47	35	28	23	40	30	25	20	21	17	14	12	10	9	4	3	3	0
9	43	32	25	20	37	28	22	18	19	15	13	11	9	8	4	3	3	0
10	40	29	22	18	34	25	19	16	17	14	11	10	8	7	3	3	2	0

POLAR GRAPH

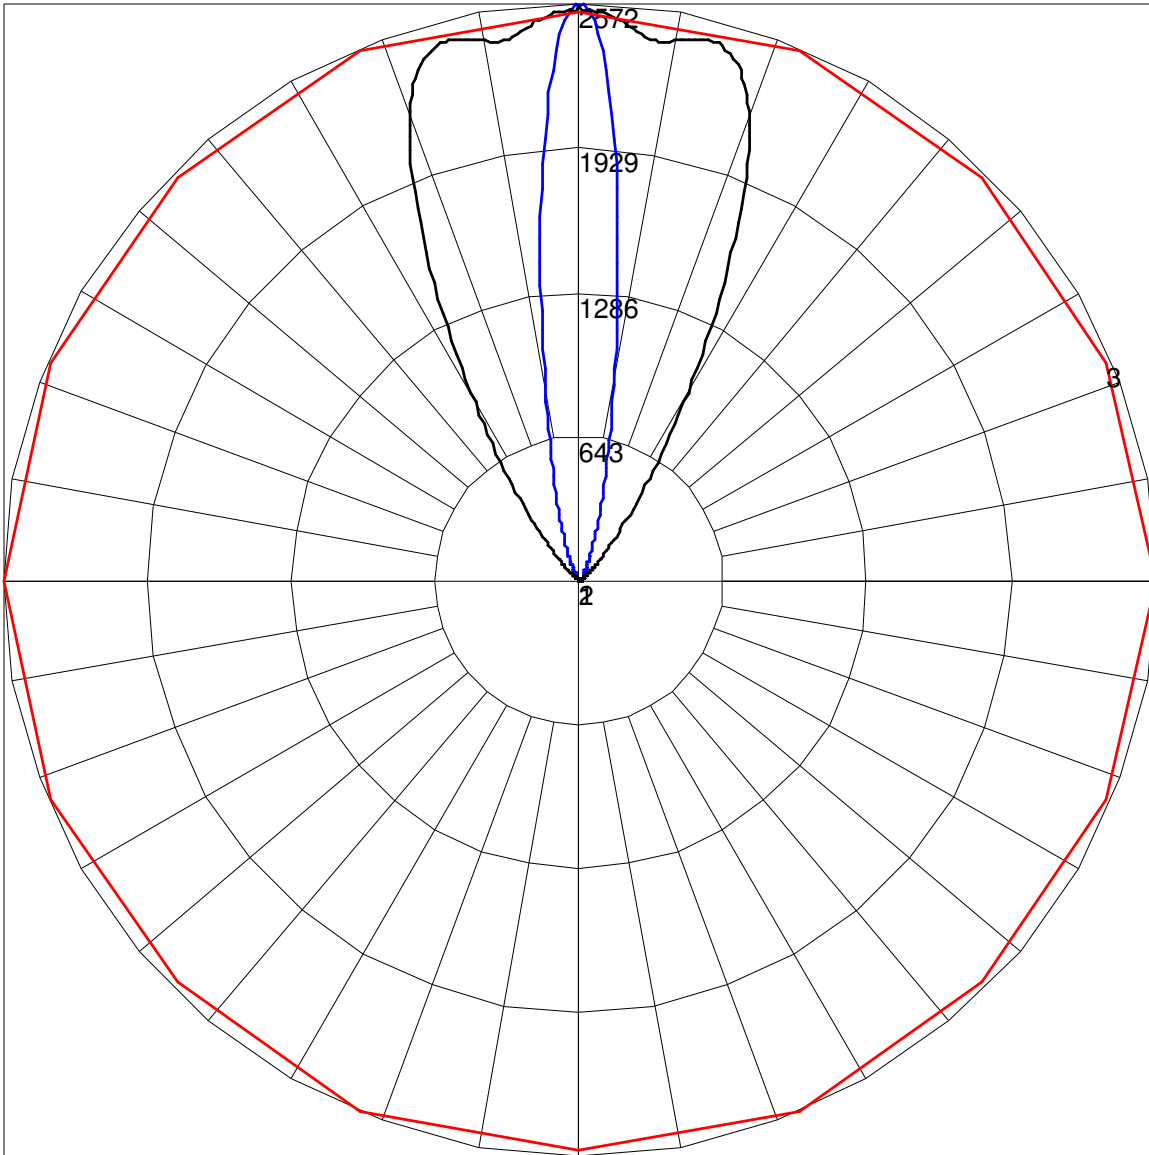

Maximum Candela = 2572 Located At Horizontal Angle = 0, Vertical Angle = 179.5

1 - Vertical Plane Through Horizontal Angles (0 - 180) (Through Max. Cd.)

2 - Vertical Plane Through Horizontal Angles (90 - 270)

3 - Horizontal Cone Through Vertical Angle (179.5) (Through Max. Cd.)