

IES INDOOR REPORT PHOTOMETRIC FILENAME : C6RX00-12-BVL12-UNVE9-D35S-NA.IES

DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002
[TEST] 11750395.23
[ECN] 3081
[TESTLAB] UL Verification Services Inc.
[ISSUE DATE] 5/11/2017
[MANUFAC] Tempo Industries Inc
[LUMCAT] C6RX00-12-BVL12-UNVE9-D35S-NA
[LUMINAIRE] Rectangular brown metal housing, louver reflectors, inner
[MORE] patterned lens, and outer clear glass lens
[LAMP] 21 White LEDs
[BALLAST] Magtech M9-U24-0350
[OTHER] 24.4 C, 120.055 V, 0.0692243 A, 8.24959 W, 0.992643 PF, 59.998
[MORE] 4 Hz
[OTHER] This test was performed using the calibrated photodetector met
[MORE] hod of absolute photometry.

CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	240
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	29
Total Luminaire Watts	8.24959
Ballast Factor	1.00
CIE Type	Indirect
Spacing Criterion (0-180)	N.A.
Spacing Criterion (90-270)	N.A.
Spacing Criterion (Diagonal)	N.A.
Basic Luminous Shape	Rectangular
Luminous Length (0-180)	0.13 ft
Luminous Width (90-270)	0.96 ft
Luminous Height	0.00 ft



IES INDOOR REPORT
PHOTOMETRIC FILENAME : C6RX00-12-BVL12-UNVE9-D35S-NA.IES

LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	0	0	0
55	0	0	0
65	0	0	0
75	0	0	0
85	0	0	0

IES INDOOR REPORT
PHOTOMETRIC FILENAME : C6RX00-12-BVL12-UNVE9-D35S-NA.IES

CANDELA TABULATION

	<u>0.0</u>	<u>22.5</u>	<u>45.0</u>	<u>67.5</u>	<u>90.0</u>
0.0	0.00	0.00	0.00	0.00	0.00
0.5	0.00	0.00	0.00	0.00	0.00
1.0	0.00	0.00	0.00	0.00	0.00
1.5	0.00	0.00	0.00	0.00	0.00
2.0	0.00	0.00	0.00	0.00	0.00
2.5	0.00	0.00	0.00	0.00	0.00
3.0	0.00	0.00	0.00	0.00	0.00
3.5	0.00	0.00	0.00	0.00	0.00
4.0	0.00	0.00	0.00	0.00	0.00
4.5	0.00	0.00	0.00	0.00	0.00
5.0	0.00	0.00	0.00	0.00	0.00
5.5	0.00	0.00	0.00	0.00	0.00
6.0	0.00	0.00	0.00	0.00	0.00
6.5	0.00	0.00	0.00	0.00	0.00
7.0	0.00	0.00	0.00	0.00	0.00
7.5	0.00	0.00	0.00	0.00	0.00
8.0	0.00	0.00	0.00	0.00	0.00
8.5	0.00	0.00	0.00	0.00	0.00
9.0	0.00	0.00	0.00	0.00	0.00
9.5	0.00	0.00	0.00	0.00	0.00
10.0	0.00	0.00	0.00	0.00	0.00
10.5	0.00	0.00	0.00	0.00	0.00
11.0	0.00	0.00	0.00	0.00	0.00
11.5	0.00	0.00	0.00	0.00	0.00
12.0	0.00	0.00	0.00	0.00	0.00
12.5	0.00	0.00	0.00	0.00	0.00
13.0	0.00	0.00	0.00	0.00	0.00
13.5	0.00	0.00	0.00	0.00	0.00
14.0	0.00	0.00	0.00	0.00	0.00
14.5	0.00	0.00	0.00	0.00	0.00
15.0	0.00	0.00	0.00	0.00	0.00
15.5	0.00	0.00	0.00	0.00	0.00
16.0	0.00	0.00	0.00	0.00	0.00
16.5	0.00	0.00	0.00	0.00	0.00
17.0	0.00	0.00	0.00	0.00	0.00
17.5	0.00	0.00	0.00	0.00	0.00
18.0	0.00	0.00	0.00	0.00	0.00
18.5	0.00	0.00	0.00	0.00	0.00
19.0	0.00	0.00	0.00	0.00	0.00
19.5	0.00	0.00	0.00	0.00	0.00
20.0	0.00	0.00	0.00	0.00	0.00
20.5	0.00	0.00	0.00	0.00	0.00
21.0	0.00	0.00	0.00	0.00	0.00
21.5	0.00	0.00	0.00	0.00	0.00
22.0	0.00	0.00	0.00	0.00	0.00
22.5	0.00	0.00	0.00	0.00	0.00
23.0	0.00	0.00	0.00	0.00	0.00
23.5	0.00	0.00	0.00	0.00	0.00
24.0	0.00	0.00	0.00	0.00	0.00
24.5	0.00	0.00	0.00	0.00	0.00
25.0	0.00	0.00	0.00	0.00	0.00
25.5	0.00	0.00	0.00	0.00	0.00
26.0	0.00	0.00	0.00	0.00	0.00
26.5	0.00	0.00	0.00	0.00	0.00

IES INDOOR REPORT
PHOTOMETRIC FILENAME : C6RX00-12-BVL12-UNVE9-D35S-NA.IES

CANDELA TABULATION - (Cont.)

27.0	0.00	0.00	0.00	0.00	0.00
27.5	0.00	0.00	0.00	0.00	0.00
28.0	0.00	0.00	0.00	0.00	0.00
28.5	0.00	0.00	0.00	0.00	0.00
29.0	0.00	0.00	0.00	0.00	0.00
29.5	0.00	0.00	0.00	0.00	0.00
30.0	0.00	0.00	0.00	0.00	0.00
30.5	0.00	0.00	0.00	0.00	0.00
31.0	0.00	0.00	0.00	0.00	0.00
31.5	0.00	0.00	0.00	0.00	0.00
32.0	0.00	0.00	0.00	0.00	0.00
32.5	0.00	0.00	0.00	0.00	0.00
33.0	0.00	0.00	0.00	0.00	0.00
33.5	0.00	0.00	0.00	0.00	0.00
34.0	0.00	0.00	0.00	0.00	0.00
34.5	0.00	0.00	0.00	0.00	0.00
35.0	0.00	0.00	0.00	0.00	0.00
35.5	0.00	0.00	0.00	0.00	0.00
36.0	0.00	0.00	0.00	0.00	0.00
36.5	0.00	0.00	0.00	0.00	0.00
37.0	0.00	0.00	0.00	0.00	0.00
37.5	0.00	0.00	0.00	0.00	0.00
38.0	0.00	0.00	0.00	0.00	0.00
38.5	0.00	0.00	0.00	0.00	0.00
39.0	0.00	0.00	0.00	0.00	0.00
39.5	0.00	0.00	0.00	0.00	0.00
40.0	0.00	0.00	0.00	0.00	0.00
40.5	0.00	0.00	0.00	0.00	0.00
41.0	0.00	0.00	0.00	0.00	0.00
41.5	0.00	0.00	0.00	0.00	0.00
42.0	0.00	0.00	0.00	0.00	0.00
42.5	0.00	0.00	0.00	0.00	0.00
43.0	0.00	0.00	0.00	0.00	0.00
43.5	0.00	0.00	0.00	0.00	0.00
44.0	0.00	0.00	0.00	0.00	0.00
44.5	0.00	0.00	0.00	0.00	0.00
45.0	0.00	0.00	0.00	0.00	0.00
45.5	0.00	0.00	0.00	0.00	0.00
46.0	0.00	0.00	0.00	0.00	0.00
46.5	0.00	0.00	0.00	0.00	0.00
47.0	0.00	0.00	0.00	0.00	0.00
47.5	0.00	0.00	0.00	0.00	0.00
48.0	0.00	0.00	0.00	0.00	0.00
48.5	0.00	0.00	0.00	0.00	0.00
49.0	0.00	0.00	0.00	0.00	0.00
49.5	0.00	0.00	0.00	0.00	0.00
50.0	0.00	0.00	0.00	0.00	0.00
50.5	0.00	0.00	0.00	0.00	0.00
51.0	0.00	0.00	0.00	0.00	0.00
51.5	0.00	0.00	0.00	0.00	0.00
52.0	0.00	0.00	0.00	0.00	0.00
52.5	0.00	0.00	0.00	0.00	0.00
53.0	0.00	0.00	0.00	0.00	0.00
53.5	0.00	0.00	0.00	0.00	0.00
54.0	0.00	0.00	0.00	0.00	0.00
54.5	0.00	0.00	0.00	0.00	0.00

IES INDOOR REPORT
PHOTOMETRIC FILENAME : C6RX00-12-BVL12-UNVE9-D35S-NA.IES

CANDELA TABULATION - (Cont.)

55.0	0.00	0.00	0.00	0.00	0.00
55.5	0.00	0.00	0.00	0.00	0.00
56.0	0.00	0.00	0.00	0.00	0.00
56.5	0.00	0.00	0.00	0.00	0.00
57.0	0.00	0.00	0.00	0.00	0.00
57.5	0.00	0.00	0.00	0.00	0.00
58.0	0.00	0.00	0.00	0.00	0.00
58.5	0.00	0.00	0.00	0.00	0.00
59.0	0.00	0.00	0.00	0.00	0.00
59.5	0.00	0.00	0.00	0.00	0.00
60.0	0.00	0.00	0.00	0.00	0.00
60.5	0.00	0.00	0.00	0.00	0.00
61.0	0.00	0.00	0.00	0.00	0.00
61.5	0.00	0.00	0.00	0.00	0.00
62.0	0.00	0.00	0.00	0.00	0.00
62.5	0.00	0.00	0.00	0.00	0.00
63.0	0.00	0.00	0.00	0.00	0.00
63.5	0.00	0.00	0.00	0.00	0.00
64.0	0.00	0.00	0.00	0.00	0.00
64.5	0.00	0.00	0.00	0.00	0.00
65.0	0.00	0.00	0.00	0.00	0.00
65.5	0.00	0.00	0.00	0.00	0.00
66.0	0.00	0.00	0.00	0.00	0.00
66.5	0.00	0.00	0.00	0.00	0.00
67.0	0.00	0.00	0.00	0.00	0.00
67.5	0.00	0.00	0.00	0.00	0.00
68.0	0.00	0.00	0.00	0.00	0.00
68.5	0.00	0.00	0.00	0.00	0.00
69.0	0.00	0.00	0.00	0.00	0.00
69.5	0.00	0.00	0.00	0.00	0.00
70.0	0.00	0.00	0.00	0.00	0.00
70.5	0.00	0.00	0.00	0.00	0.00
71.0	0.00	0.00	0.00	0.00	0.00
71.5	0.00	0.00	0.00	0.00	0.00
72.0	0.00	0.00	0.00	0.00	0.00
72.5	0.00	0.00	0.00	0.00	0.00
73.0	0.00	0.00	0.00	0.00	0.00
73.5	0.00	0.00	0.00	0.00	0.00
74.0	0.00	0.00	0.00	0.00	0.00
74.5	0.00	0.00	0.00	0.00	0.00
75.0	0.00	0.00	0.00	0.00	0.00
75.5	0.00	0.00	0.00	0.00	0.00
76.0	0.00	0.00	0.00	0.00	0.00
76.5	0.00	0.00	0.00	0.00	0.00
77.0	0.00	0.00	0.00	0.00	0.00
77.5	0.00	0.00	0.00	0.00	0.00
78.0	0.00	0.00	0.00	0.00	0.00
78.5	0.00	0.00	0.00	0.00	0.00
79.0	0.00	0.00	0.00	0.00	0.00
79.5	0.00	0.00	0.00	0.00	0.00
80.0	0.00	0.00	0.00	0.00	0.00
80.5	0.00	0.00	0.00	0.00	0.00
81.0	0.00	0.00	0.00	0.00	0.00
81.5	0.00	0.00	0.00	0.00	0.00
82.0	0.00	0.00	0.00	0.00	0.00
82.5	0.00	0.00	0.00	0.00	0.00

IES INDOOR REPORT
PHOTOMETRIC FILENAME : C6RX00-12-BVL12-UNVE9-D35S-NA.IES

CANDELA TABULATION - (Cont.)

83.0	0.00	0.00	0.00	0.00	0.00
83.5	0.00	0.00	0.00	0.00	0.00
84.0	0.00	0.00	0.00	0.00	0.00
84.5	0.00	0.00	0.00	0.00	0.00
85.0	0.00	0.00	0.00	0.00	0.00
85.5	0.00	0.00	0.00	0.00	0.00
86.0	0.00	0.00	0.00	0.00	0.00
86.5	0.00	0.00	0.00	0.00	0.00
87.0	0.00	0.00	0.00	0.00	0.00
87.5	0.00	0.00	0.00	0.00	0.00
88.0	0.00	0.00	0.00	0.00	0.00
88.5	0.00	0.00	0.00	0.00	0.00
89.0	0.00	0.00	0.00	0.00	0.00
89.5	0.00	0.00	0.00	0.00	0.00
90.0	0.00	0.00	0.00	0.00	0.00
90.5	0.02	0.03	0.02	0.02	0.01
91.0	0.04	0.04	0.03	0.03	0.02
91.5	0.07	0.05	0.04	0.04	0.04
92.0	0.08	0.07	0.05	0.06	0.07
92.5	0.10	0.09	0.08	0.08	0.08
93.0	0.13	0.11	0.09	0.10	0.09
93.5	0.16	0.14	0.11	0.12	0.12
94.0	0.18	0.16	0.13	0.13	0.13
94.5	0.20	0.17	0.15	0.16	0.15
95.0	0.23	0.19	0.16	0.17	0.19
95.5	0.25	0.22	0.18	0.19	0.20
96.0	0.28	0.24	0.20	0.21	0.22
96.5	0.31	0.27	0.22	0.23	0.24
97.0	0.33	0.29	0.25	0.25	0.27
97.5	0.37	0.32	0.27	0.28	0.29
98.0	0.40	0.35	0.29	0.31	0.31
98.5	0.43	0.38	0.32	0.33	0.35
99.0	0.47	0.40	0.33	0.36	0.37
99.5	0.50	0.43	0.36	0.38	0.39
100.0	0.54	0.46	0.37	0.40	0.43
100.5	0.58	0.48	0.40	0.43	0.45
101.0	0.62	0.53	0.43	0.46	0.47
101.5	0.65	0.56	0.45	0.48	0.51
102.0	0.70	0.58	0.47	0.51	0.55
102.5	0.74	0.62	0.50	0.54	0.58
103.0	0.78	0.66	0.53	0.56	0.61
103.5	0.84	0.69	0.56	0.59	0.64
104.0	0.88	0.73	0.59	0.63	0.68
104.5	0.93	0.77	0.62	0.66	0.72
105.0	0.98	0.81	0.64	0.69	0.74
105.5	1.05	0.84	0.68	0.73	0.80
106.0	1.10	0.89	0.70	0.76	0.83
106.5	1.14	0.93	0.74	0.79	0.86
107.0	1.20	0.97	0.77	0.82	0.91
107.5	1.28	1.03	0.81	0.87	0.96
108.0	1.35	1.08	0.84	0.90	1.01
108.5	1.41	1.13	0.87	0.94	1.04
109.0	1.49	1.18	0.92	0.99	1.09
109.5	1.56	1.23	0.94	1.02	1.13
110.0	1.63	1.29	0.98	1.06	1.19
110.5	1.73	1.35	1.02	1.11	1.26

IES INDOOR REPORT
PHOTOMETRIC FILENAME : C6RX00-12-BVL12-UNVE9-D35S-NA.IES

CANDELA TABULATION - (Cont.)

111.0	1.81	1.40	1.06	1.15	1.29
111.5	1.89	1.47	1.10	1.19	1.35
112.0	1.99	1.54	1.14	1.25	1.40
112.5	2.10	1.61	1.18	1.29	1.46
113.0	2.20	1.68	1.22	1.35	1.54
113.5	2.30	1.76	1.27	1.39	1.59
114.0	2.42	1.84	1.32	1.46	1.66
114.5	2.55	1.94	1.36	1.52	1.74
115.0	2.66	2.02	1.42	1.58	1.80
115.5	2.81	2.12	1.45	1.64	1.87
116.0	2.93	2.21	1.52	1.70	1.99
116.5	3.08	2.32	1.58	1.78	2.09
117.0	3.22	2.42	1.63	1.85	2.16
117.5	3.37	2.57	1.68	1.95	2.27
118.0	3.54	2.63	1.73	2.02	2.36
118.5	3.73	2.74	1.82	2.12	2.48
119.0	3.94	2.83	1.90	2.24	2.63
119.5	4.08	2.86	1.92	2.26	2.70
120.0	4.21	2.99	1.99	2.38	2.80
120.5	4.33	3.13	2.10	2.52	3.00
121.0	4.36	3.23	2.16	2.60	3.12
121.5	4.39	3.43	2.26	2.74	3.27
122.0	4.51	3.60	2.35	2.87	3.42
122.5	4.69	3.76	2.43	2.98	3.57
123.0	4.95	3.95	2.52	3.13	3.73
123.5	5.19	4.10	2.62	3.27	3.86
124.0	5.44	4.24	2.75	3.42	4.05
124.5	5.75	4.36	2.89	3.56	4.22
125.0	6.06	4.51	3.06	3.74	4.38
125.5	6.25	4.72	3.23	3.90	4.57
126.0	6.37	4.98	3.44	4.07	4.76
126.5	6.46	5.30	3.66	4.25	4.92
127.0	6.55	5.65	3.89	4.43	5.13
127.5	6.66	6.03	4.14	4.63	5.32
128.0	6.92	6.38	4.40	4.84	5.50
128.5	7.42	6.73	4.66	5.04	5.70
129.0	8.09	7.07	4.95	5.26	5.91
129.5	8.71	7.39	5.23	5.48	6.12
130.0	9.21	7.73	5.55	5.72	6.32
130.5	9.71	8.07	5.85	6.00	6.53
131.0	10.11	8.40	6.17	6.49	6.74
131.5	10.54	8.73	6.52	7.28	6.94
132.0	10.99	9.07	6.86	8.37	7.17
132.5	11.43	9.42	7.25	9.77	7.40
133.0	11.87	9.74	7.65	11.51	7.86
133.5	12.29	10.07	8.06	13.61	8.68
134.0	12.73	10.39	8.49	15.96	9.90
134.5	13.13	10.70	8.94	18.46	11.42
135.0	13.51	11.02	9.45	21.08	13.24
135.5	13.87	11.34	9.97	23.82	15.54
136.0	14.18	11.62	10.52	26.67	18.22
136.5	14.51	11.96	11.11	29.64	20.94
137.0	14.81	12.26	11.77	32.73	23.80
137.5	15.11	12.58	12.46	35.87	26.79
138.0	15.37	12.93	13.22	39.11	29.80
138.5	15.68	13.28	14.07	42.46	32.97

IES INDOOR REPORT**PHOTOMETRIC FILENAME : C6RX00-12-BVL12-UNVE9-D35S-NA.IES****CANDELA TABULATION - (Cont.)**

139.0	15.89	13.67	15.06	45.83	36.13
139.5	16.19	14.05	16.20	49.35	39.39
140.0	16.30	14.48	17.57	52.95	42.69
140.5	16.64	14.96	19.38	56.59	46.09
141.0	17.03	15.46	21.55	60.30	49.60
141.5	17.42	15.95	24.58	64.06	53.24
142.0	17.80	16.58	28.42	67.92	56.91
142.5	18.28	17.21	33.21	71.89	60.71
143.0	18.77	17.88	39.06	75.84	64.59
143.5	19.41	18.58	46.03	79.78	68.41
144.0	20.05	19.27	53.94	83.75	72.32
144.5	20.70	20.10	62.59	87.75	76.24
145.0	21.45	20.98	72.02	91.84	80.16
145.5	22.22	22.04	81.62	95.88	84.36
146.0	23.02	23.20	91.03	99.85	88.45
146.5	23.94	24.57	100.10	104.00	92.53
147.0	24.86	26.31	109.00	108.00	96.49
147.5	25.91	28.53	117.30	112.00	100.20
148.0	27.17	31.74	125.10	115.90	104.10
148.5	28.56	36.39	132.30	119.90	108.00
149.0	30.33	42.98	139.20	124.00	112.10
149.5	32.61	52.47	145.50	127.80	115.70
150.0	35.86	65.25	151.60	131.70	119.60
150.5	40.68	81.21	157.00	135.70	123.30
151.0	48.17	99.99	162.20	139.60	127.20
151.5	59.56	120.60	167.10	143.40	130.90
152.0	76.21	141.60	171.80	147.20	134.70
152.5	98.47	161.50	176.20	151.20	138.60
153.0	124.40	179.40	180.40	154.90	142.30
153.5	153.70	194.40	184.60	158.50	145.90
154.0	182.00	206.70	188.60	162.40	149.90
154.5	207.50	216.30	192.20	166.00	153.70
155.0	227.90	224.00	196.10	169.70	157.30
155.5	243.40	230.20	199.80	173.60	161.00
156.0	254.60	235.10	203.30	177.40	164.80
156.5	262.30	239.50	206.80	180.90	168.70
157.0	267.50	242.80	210.20	184.60	172.20
157.5	272.00	246.50	213.60	188.40	176.20
158.0	275.00	249.10	217.20	192.10	180.00
158.5	277.70	251.80	220.90	195.80	184.10
159.0	280.20	254.40	224.10	199.50	187.70
159.5	282.10	257.00	227.30	203.30	191.80
160.0	284.00	259.40	230.80	206.90	195.70
160.5	285.60	261.50	234.00	210.60	199.70
161.0	287.10	263.80	237.30	214.40	203.30
161.5	288.80	266.20	240.40	218.00	207.30
162.0	290.10	268.30	243.50	221.60	210.80
162.5	291.70	270.60	246.80	225.00	214.50
163.0	293.40	272.70	249.40	228.50	218.40
163.5	294.60	274.80	252.20	232.10	221.90
164.0	296.20	276.90	254.90	235.20	225.80
164.5	297.80	279.00	257.30	238.90	229.50
165.0	298.70	281.10	259.80	242.10	233.00
165.5	299.90	282.60	262.10	245.20	236.40
166.0	301.50	284.50	264.50	248.20	240.00
166.5	302.80	286.50	267.00	251.60	243.40

IES INDOOR REPORT
PHOTOMETRIC FILENAME : C6RX00-12-BVL12-UNVE9-D35S-NA.IES

CANDELA TABULATION - (Cont.)

167.0	304.00	288.00	269.20	254.60	246.90
167.5	304.80	289.40	271.40	257.70	250.40
168.0	305.60	291.00	273.90	260.40	253.40
168.5	306.40	292.20	275.90	263.30	256.40
169.0	306.70	293.50	277.90	266.10	259.20
169.5	306.90	294.70	280.10	268.80	262.40
170.0	307.30	296.00	282.10	271.50	265.20
170.5	307.40	297.10	284.10	274.00	267.90
171.0	307.70	298.20	286.10	276.70	270.60
171.5	308.10	299.40	287.80	279.00	273.70
172.0	308.50	300.40	289.70	281.40	276.10
172.5	308.70	301.40	291.40	283.70	279.10
173.0	309.50	302.00	293.10	286.10	281.50
173.5	309.50	302.80	294.50	287.90	284.10
174.0	309.60	303.70	296.20	290.20	286.30
174.5	310.00	304.50	297.80	292.10	288.30
175.0	310.00	305.10	299.40	294.20	290.80
175.5	310.00	305.70	300.80	296.30	292.70
176.0	309.70	306.40	302.20	297.80	294.70
176.5	309.70	306.80	303.40	300.00	297.00
177.0	309.60	307.00	304.40	301.90	298.70
177.5	309.00	307.20	305.40	303.40	300.40
178.0	308.90	307.40	306.20	304.90	302.00
178.5	308.80	307.80	306.80	306.10	303.40
179.0	308.40	308.10	307.10	306.80	304.10
179.5	308.60	307.70	307.20	307.00	304.60
180.0	307.10	307.10	307.10	307.10	307.10

IES INDOOR REPORT
PHOTOMETRIC FILENAME : C6RX00-12-BVL12-UNVE9-D35S-NA.IES

ZONAL LUMEN SUMMARY

Zone	Lumens	%Lamp	%Fixt
0-20	0.00	N.A.	0.00
0-30	0.00	N.A.	0.00
0-40	0.00	N.A.	0.00
0-60	0.00	N.A.	0.00
0-80	0.00	N.A.	0.00
0-90	0.00	N.A.	0.00
10-90	0.00	N.A.	0.00
20-40	0.00	N.A.	0.00
20-50	0.00	N.A.	0.00
40-70	0.00	N.A.	0.00
60-80	0.00	N.A.	0.00
70-80	0.00	N.A.	0.00
80-90	0.00	N.A.	0.00
90-110	1.02	N.A.	0.40
90-120	2.87	N.A.	1.20
90-130	6.71	N.A.	2.80
90-150	55.59	N.A.	23.10
90-180	240.41	N.A.	100.00
110-180	239.38	N.A.	99.60
0-180	240.41	N.A.	100.00

Total Luminaire Efficiency = N.A.%

ZONAL LUMEN SUMMARY

Zone	Lumens
0-10	0.00
10-20	0.00
20-30	0.00
30-40	0.00
40-50	0.00
50-60	0.00
60-70	0.00
70-80	0.00
80-90	0.00
90-100	0.21
100-110	0.81
110-120	1.84
120-130	3.84
130-140	11.41
140-150	37.48
150-160	83.45
160-170	73.26
170-180	28.10


IES INDOOR REPORT
PHOTOMETRIC FILENAME : C6RX00-12-BVL12-UNVE9-D35S-NA.IES

COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
	RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	
0	95	95	95	95	82	82	82	82	56	56	56	32	32	32	10	10	10	0
1	87	83	79	76	74	71	68	65	48	47	45	28	27	26	9	9	9	0
2	79	72	67	62	67	62	57	53	42	40	37	24	23	22	8	7	7	0
3	72	63	57	51	61	54	49	44	37	34	31	21	20	18	7	6	6	0
4	66	56	49	43	56	48	42	37	33	29	26	19	17	16	6	6	5	0
5	60	49	42	36	51	42	36	32	29	25	22	17	15	13	5	5	4	0
6	55	44	37	31	47	38	32	27	26	22	19	15	13	11	5	4	4	0
7	51	39	32	27	43	34	28	23	23	19	17	14	11	10	4	4	3	0
8	47	35	28	23	40	30	25	20	21	17	14	12	10	9	4	3	3	0
9	43	32	25	20	37	28	22	18	19	15	13	11	9	8	4	3	3	0
10	40	29	22	18	34	25	19	16	17	14	11	10	8	7	3	3	2	0

POLAR GRAPH

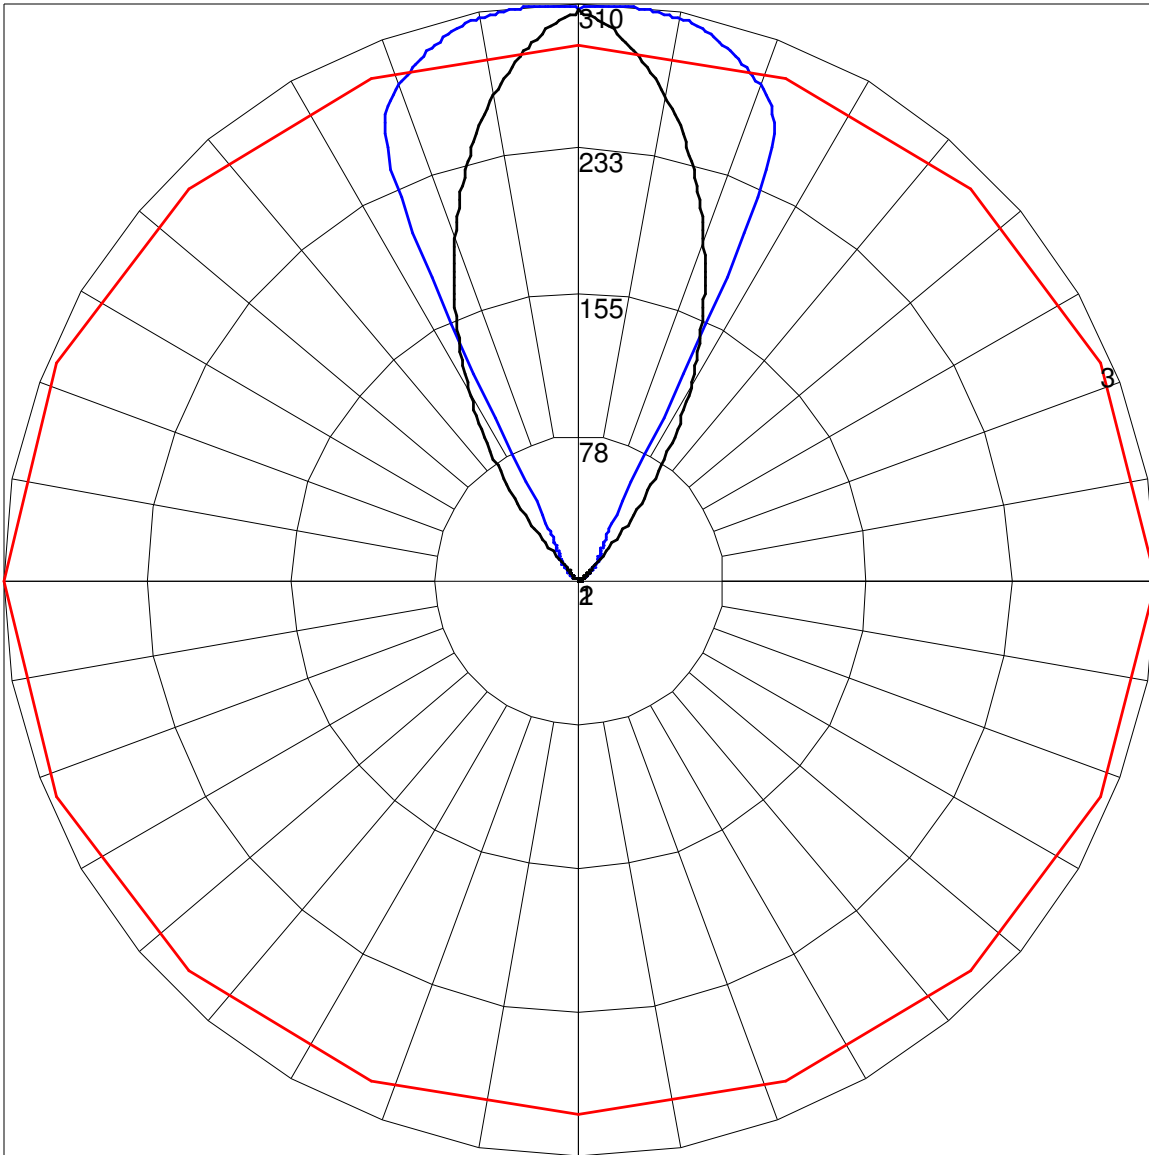

Maximum Candela = 310 Located At Horizontal Angle = 0, Vertical Angle = 174.5

1 - Vertical Plane Through Horizontal Angles (0 - 180) (Through Max. Cd.)

2 - Vertical Plane Through Horizontal Angles (90 - 270)

3 - Horizontal Cone Through Vertical Angle (174.5) (Through Max. Cd.)